

### Promedio Anual Móvil

El RAA se determina promediando las cuatro (4) muestras trimestrales anteriores. Al final de cada trimestre, el cumplimiento se basa en el RAA de las muestras trimestrales. Si el RAA está en o por debajo del Nivel Máximo de Contaminación (MCL) de 10 partes por billón (ppb), el sistema está en cumplimiento.

[Entrada Fronteriza ATF](#)

[ATF de la comunidad de Santa Teresa](#)

[Santa Teresa Industrial ATF](#)

[Sunland Park ATF](#)


### Resultados de la prueba de muestra de agua de arsénico

CRRUA opera cuatro Instalaciones de Tratamiento de Arsénico (ATF, por sus siglas en inglés) y en enero de 2024 inició pruebas voluntarias dos veces al mes en las cuatro instalaciones.

En mayo de 2024, la CRRUA excluyó a la instalación de entrada fronteriza de sus pruebas voluntarias dos veces al mes debido a que seguía cumpliendo con todos los requisitos de NMED. (CRRUA incluyó la instalación de Entrada Fronteriza en la segunda de dos pruebas de arsénico de julio de 2024).

En junio de 2024, CRRUA pasó de realizar pruebas voluntarias dos veces al mes debido a que seguía cumpliendo con todos los requisitos de NMED. (CRRUA realizó dos pruebas voluntarias de arsénico en julio de 2024). NMED realiza pruebas trimestrales.

Un video sobre el proceso de eliminación de arsénico está disponible en el canal de YouTube de CRRUA en [www.youtube.com/@crrua\\_info](http://www.youtube.com/@crrua_info).

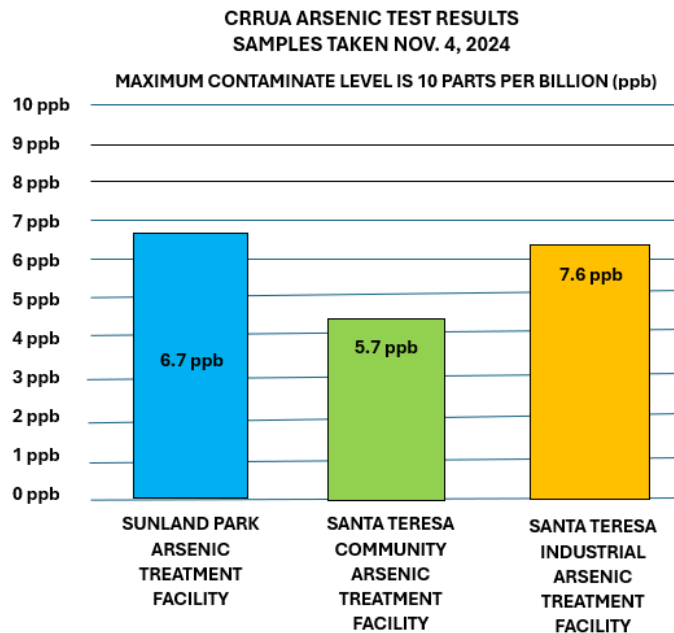


-Continued-

**Samples Taken Oct. 22, 2024**

**NEW MEXICO ENVIRONMENT DEPARTMENT  
CRRUA 4<sup>th</sup> Quarter 2024 Arsenic Test Results**


MAXIMUM CONTAMINATE LEVEL (MCL) IS 10 PARTS PER BILLION (ppb)

**ARSENIC TREATMENT FACILITY (ATF)**

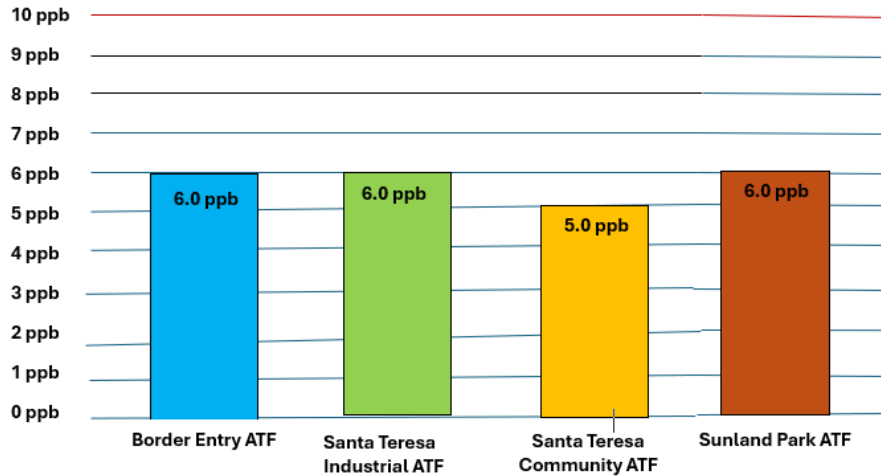

**CRRUA ARSENIC TEST RESULTS/OCT. 1, 2024**

MAXIMUM CONTAMINATE LEVEL IS 10 PARTS PER BILLION

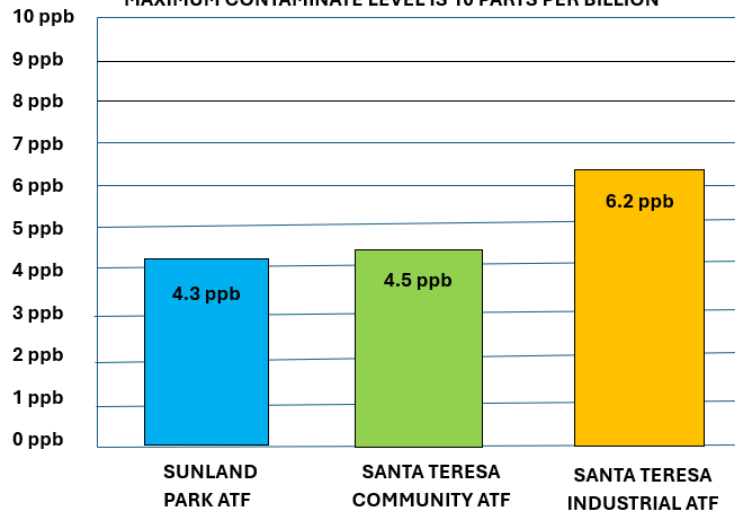

**CRRUA RESULTS/SEPT. 9, 2024**

Sample Location Arsenic Treatment Facility (ATF)	Sample Result (ppb)	Arsenic MCL 10 (ppb)
Sunland Park ATF	8.4	<b>Below MCL</b>
Santa Teresa Community ATF	6.4	<b>Below MCL</b>
Santa Teresa Industrial Park ATF	6.6	<b>Below MCL</b>
Border Entry ATF	Excluded	N/A

<b>CRRUA RESULTS/AUG. 21, 2024</b>		
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	9.5	Below MCL
Santa Teresa Community (ATF)	5.8	Below MCL
Santa Teresa Industrial Park (ATF)	7.8	Below MCL
Border Entry (ATF)	Excluded	N/A

<b>CRRUA RESULTS/JULY 31, 2024</b>		
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	8.8	Below MCL
Santa Teresa Community (ATF)	5.6	Below MCL
Santa Teresa Industrial Park (ATF)	3.8	Below MCL
Border Entry (ATF)	3.2	Below MCL

<b>NMED RESULTS/July 30, 2024 3<sup>rd</sup> QUARTER TEST</b>		
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Santa Teresa Border Entry (ATF)	3.0	Below MCL
Industrial Park Arsenic (ATF)	4.0	Below MCL
*Sunland Park Arsenic (ATF)	9.0	Below MCL
Santa Teresa Community	5.0	Below MCL

<b>*CRRUA RESULTS/JULY 2, 2024</b>		
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	7.2	Below MCL
Santa Teresa Community (ATF)	4.9	Below MCL
Santa Teresa Industrial Park (ATF)	7.3	Below MCL
Border Entry (ATF)	Excluded	N/A

<b>*CRRUA RESULTS/JUNE 11, 2024</b>		
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	8.2	Below MCL
Santa Teresa Community (ATF)	7.2	Below MCL
Santa Teresa Industrial Park (ATF)	13.0	Above MCL
Border Entry (ATF)	Excluded	N/A

<b>*CRRUA RESULTS/MAY 21, 2024</b>	<b>NMED Certified Lab</b>	
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	7.0	Below MCL
Santa Teresa Community (ATF)	4.1	Below MCL
Santa Teresa Industrial Park (ATF)	4.5	Below MCL
Border Entry (ATF)	Excluded	N/A

<b>*CRRUA RESULTS/MAY 7, 2024</b>		
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	5.0	Below MCL
Santa Teresa Community (ATF)	2.8	Below MCL
Santa Teresa Industrial Park (ATF)	4.1	Below MCL
Border Entry (ATF)	Excluded	N/A

<b>*CRRUA RESULTS/APRIL 16, 2024</b>	<b>NMED Certified Lab</b>	
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	3.0	Below MCL
Santa Teresa Community (ATF)	4.5	Below MCL
Santa Teresa Industrial Park (ATF)	3.0	Below MCL
Border Entry (ATF)	Excluded	N/A

<b>NMED RESULTS/APRIL 3, 2024 2<sup>nd</sup> QUARTER TEST</b>		
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Storage Tank #1 (Border Entry)	3.0	Below MCL
Industrial Park Arsenic (ATF)	7.0	Below MCL
Sunland Park Arsenic (ATF)	5.0	Below MCL
Santa Teresa Community	6.0	Below MCL

<b>CRRUA RESULTS/APRIL 2, 2024</b>	<b>NMED Certified Lab</b>	
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Loves Truck Stop Hose Bib #5	7.9	Below MCL
Santa Teresa Community (ATF)	4.6	Below MCL
Santa Teresa Industrial Park (ATF)	7.4	Below MCL
Sunland Park	4.4	Below MCL

<b>CRRUA RESULTS/MARCH 18, 2024</b>	<b>NMED Certified Lab</b>	
<b>Sample Location</b>	<b>Sample Result (ppb)</b>	<b>Arsenic MCL 10 (ppb)</b>
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	No Detection	Below MCL
Santa Teresa Community (ATF)	9.7	Below MCL
Santa Teresa Industrial Park (ATF)	6.6	Below MCL
Border Entry (ATF)	No Detection	Below MCL

CRRUA RESULTS/MARCH 6, 2024		NMED Certified Lab
Sample Location	Sample Result (ppb)	Arsenic MCL 10 (ppb)
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	6.8	Below MCL
Santa Teresa Community (ATF)	7.3	Below MCL
Santa Teresa Industrial Park (ATF)	9.4	Below MCL
Border Entry (ATF)	2.9	Below MCL

CRRUA RESULTS/FEBRUARY 7, 2024		NMED Certified Lab
Sample Location	Sample Result (ppb)	Arsenic MCL 10 (ppb)
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	3.0	Below MCL
Santa Teresa Community (ATF)	9.8	Below MCL
Santa Teresa Industrial Park (ATF)	1.7	Below MCL
Border Entry (ATF)	3.3	Below MCL

CRRUA RESULTS/JANUARY 24, 2024		NMED Certified Lab
Sample Location	Sample Result (ppb)	Arsenic MCL 10 (ppb)
Arsenic Treatment Facility (ATF)		
Sunland Park (ATF)	9.6	Below MCL
Santa Teresa Industrial (ATF)	8.4	Below MCL
Santa Teresa Community (ATF)	3.5	Below MCL
Border Entry (ATF)	3.0	Below MCL