




News Release

Date: 07/19/2025

All Four CRRUA Arsenic Treatment Facilities Pass NMED Third Quarter Test and Remain NMED Compliant

Results of third quarter 2025 (July – September) water tests conducted by the New Mexico Environment Department (NMED) Drinking Water Bureau (DWB) show that all four arsenic treatment facilities (ATF) operated by the Camino Real Regional Utility Authority (CRRUA) remain NMED compliant based on the department’s Running Annual Average (RAA.)

Tests results from samples the NMED DWB took on July 1, 2025, show that water treated at all four ATFs are below the federal Maximum Contaminant Level (MCL) of 10 parts per billion (ppb).

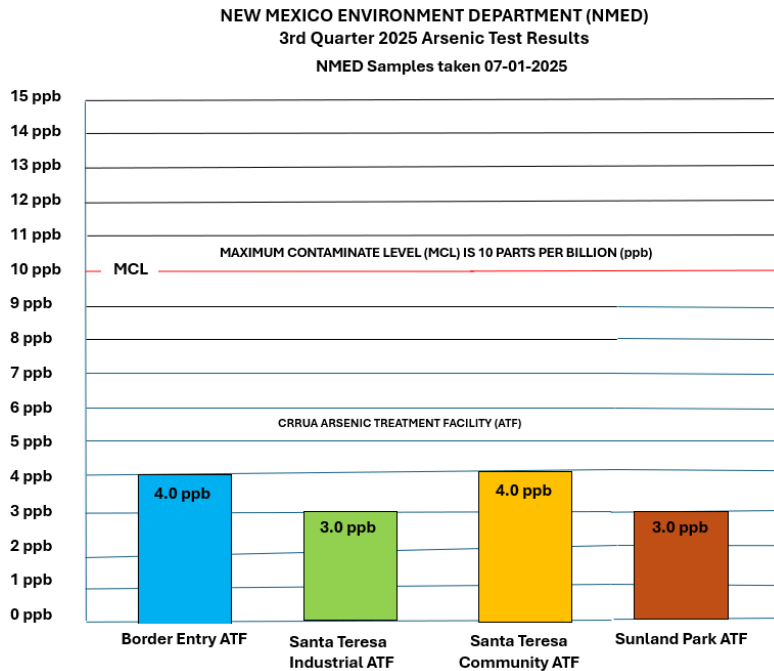


“This is the third straight NMED quarterly compliance test period in which all four CRRUA ATFs passed based on the RAA,” said CRRUA Executive Director Juan Crosby.

The RAA is determined by adding the previous four quarterly NMED test results for each ATF and dividing each total by four.

	10/22/24	1/28/25	5/7/25	7/1/25	Total	RAA
ST #1	0.006	0.003	0.003	0.004	0.0160	0.0040
INDUSTIRAL	0.006	0.008	0.015	0.003	0.0320	0.0080
STC	0.005	0.007	0.005	0.004	0.0210	0.0053
SP	0.006	0.003	0.007	0.003	0.0190	0.0048

The test results chart below shows the overall trend from January 2024, when Juan Crosby became interim executive director, thru July 1, 2025. It includes both NMED quarterly test results and CRRUA operational control test results.

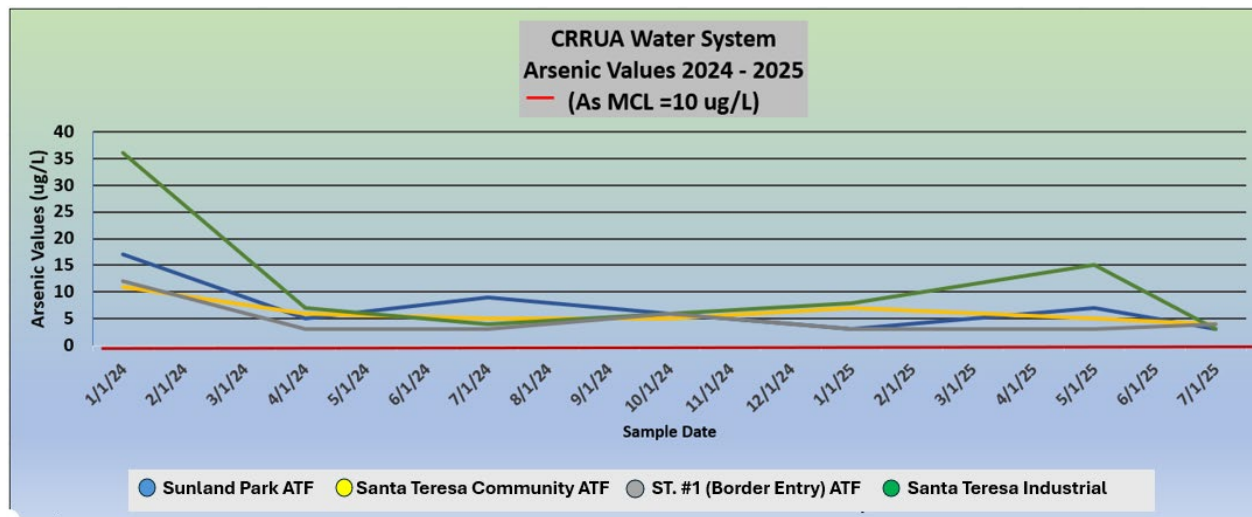

“CRRUA continues to remain compliant with arsenic standards under the Safe Drinking Water Act,” Crosby added.

CRRUA provides all arsenic test results on the home page of its website at crrua.org and on Facebook at facebook.com/crruainfo.